


LAB ROOM 271

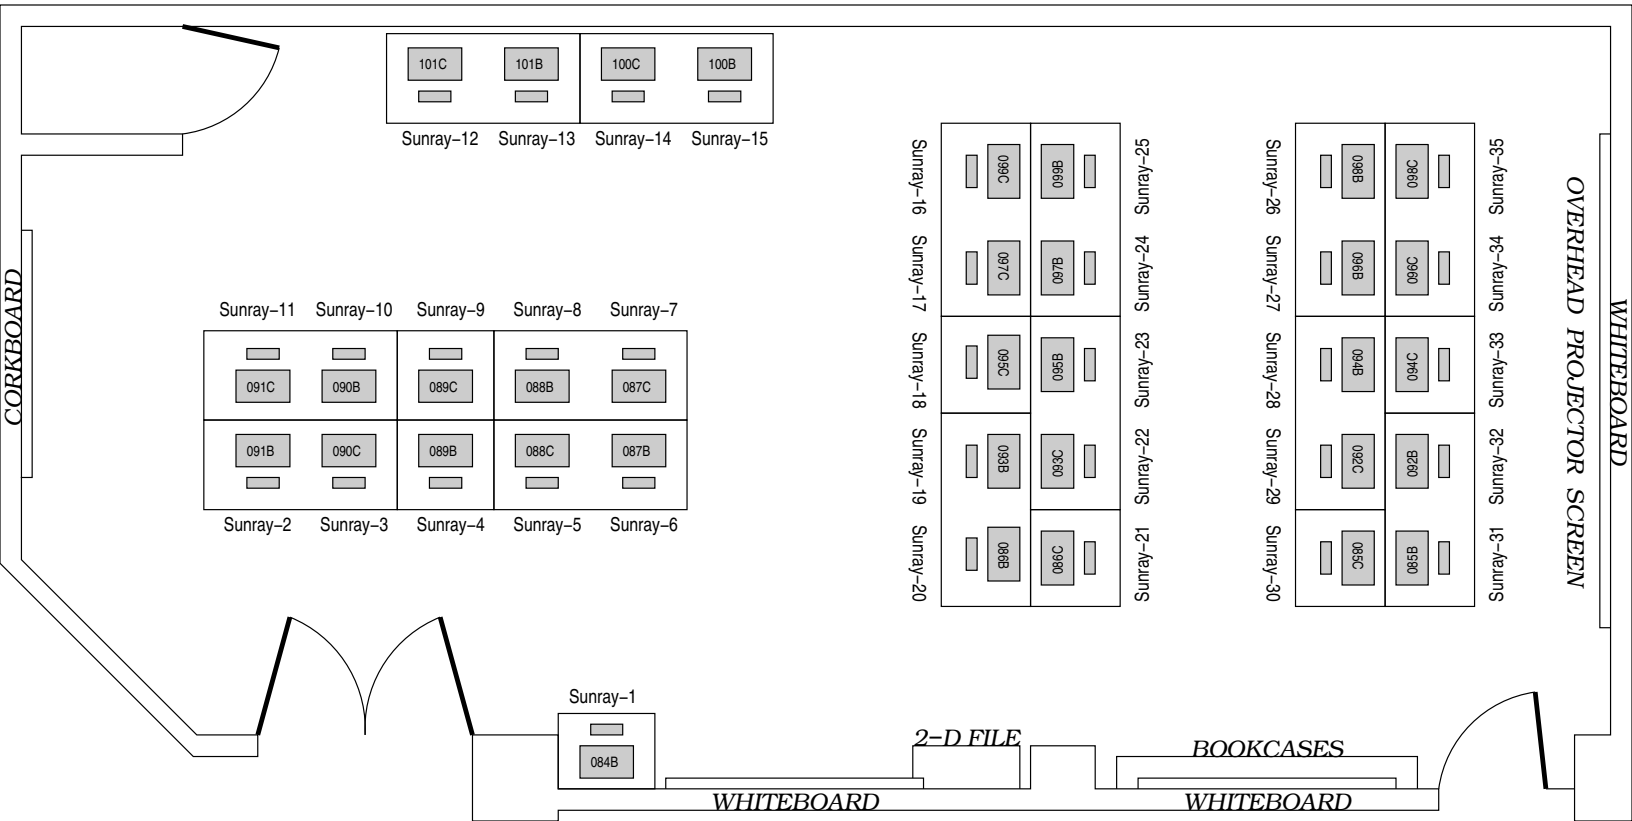

PORT USAGE

2A-084-B +	2A-089-B +	2A-094-B +	2A-099-B +
2A-084-C -	2A-089-C +	2A-094-C +	2A-099-C +
2A-085-B +	2A-090-B +	2A-095-B +	2A-100-B +
2A-085-C +	2A-090-C +	2A-095-C +	2A-100-C +
2A-086-B +	2A-091-B +	2A-096-B +	2A-101-B +
2A-086-C +	2A-091-C +	2A-096-C +	2A-101-C +
2A-087-B +	2A-092-B +	2A-097-B +	
2A-087-C +	2A-092-C +	2A-097-C +	
2A-088-B +	2A-093-B +	2A-098-B +	
2A-088-C +	2A-093-C +	2A-098-C +	

+ active

- inactive