


LAB ROOM 273

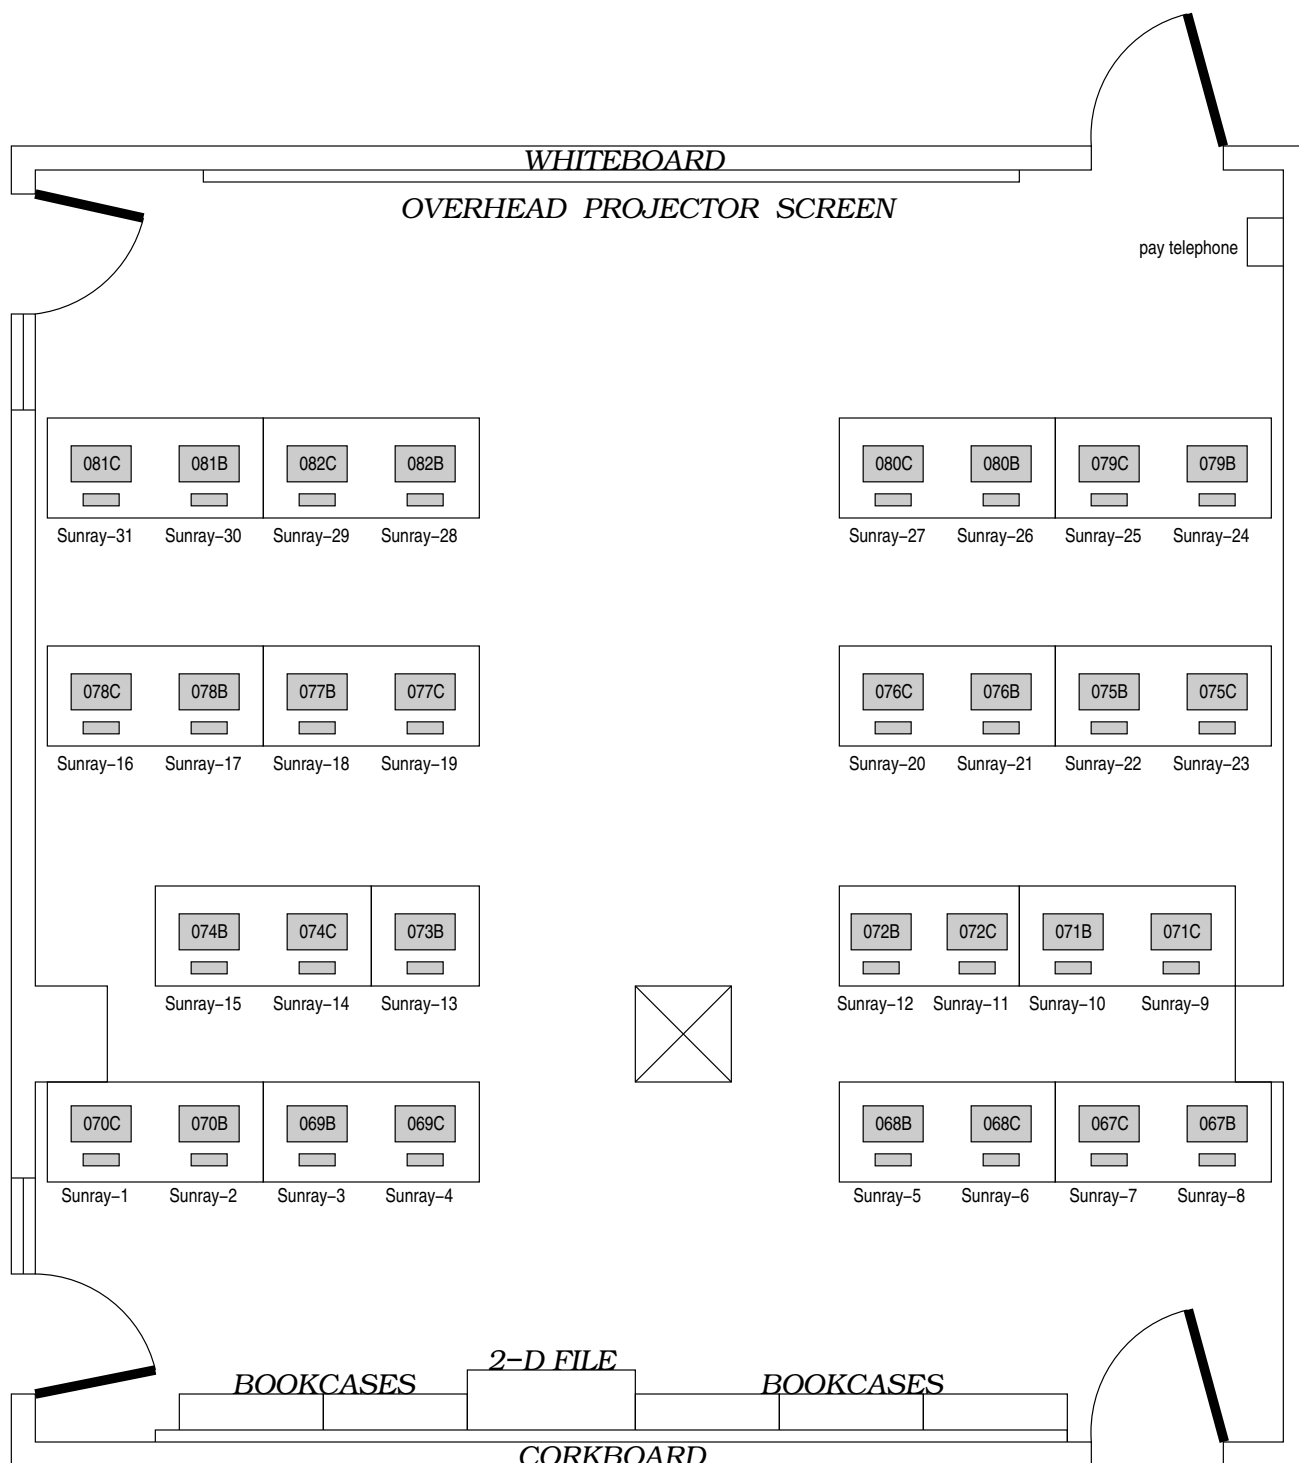

PORT USAGE

2A-067-B +	2A-072-B +	2A-077-B +	2A-082-B +
2A-067-C +	2A-072-C +	2A-077-C +	2A-082-C +
2A-068-B +	2A-073-B +	2A-078-B +	2A-083-B -
2A-068-C +	2A-073-C -	2A-078-C +	2A-083-C -
2A-069-B +	2A-074-B +	2A-079-B +	
2A-069-C +	2A-074-C +	2A-079-C +	
2A-070-B +	2A-075-B +	2A-080-B +	
2A-070-C +	2A-075-C +	2A-080-C +	
2A-071-B +	2A-076-B +	2A-081-B +	
2A-071-C +	2A-076-C +	2A-081-C +	

+ active

- inactive