


LAB ROOM 330 Soda

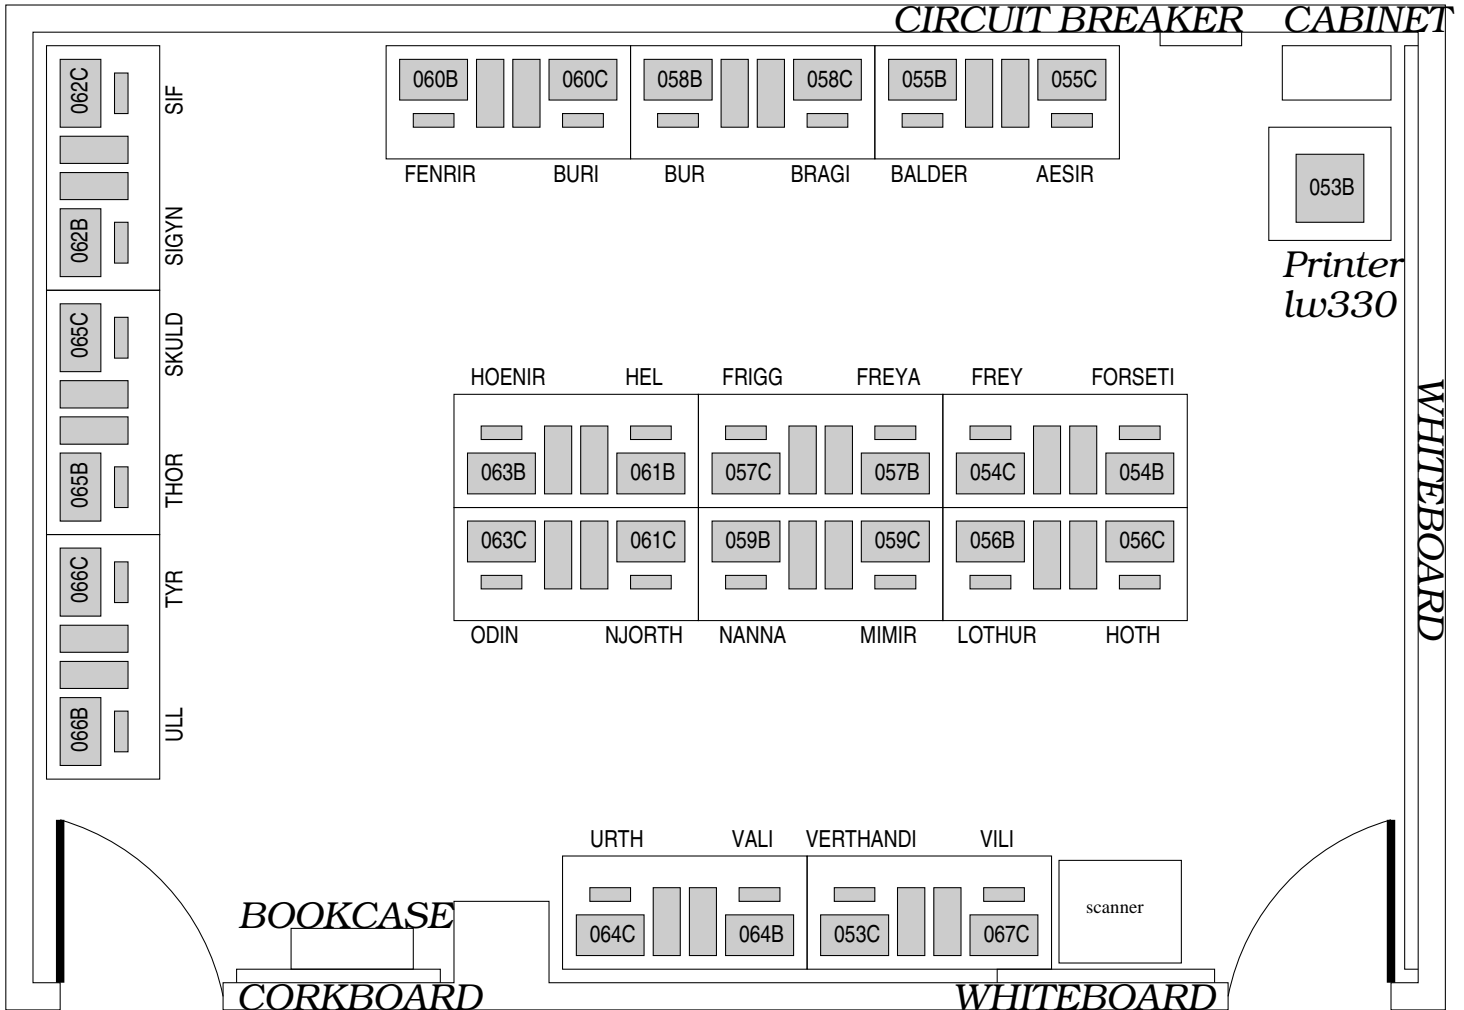

PORT USAGE

| | | |
|------------|------------|------------|
| 3B-053-B + | 3B-058-B + | 3B-063-B + |
| 3B-053-C + | 3B-058-C + | 3B-063-C + |
| 3B-054-B + | 3B-059-B + | 3B-064-B + |
| 3B-054-C + | 3B-059-C + | 3B-064-C + |
| 3B-055-B + | 3B-060-B + | 3B-065-B + |
| 3B-055-C + | 3B-060-C + | 3B-065-C + |
| 3B-056-B + | 3B-061-B + | 3B-066-B + |
| 3B-056-C + | 3B-061-C + | 3B-066-C + |
| 3B-057-B + | 3B-062-B + | 3B-067-B - |
| 3B-057-C + | 3B-062-C + | 3B-067-C + |

+ active - inactive