


# LAB ROOM 275

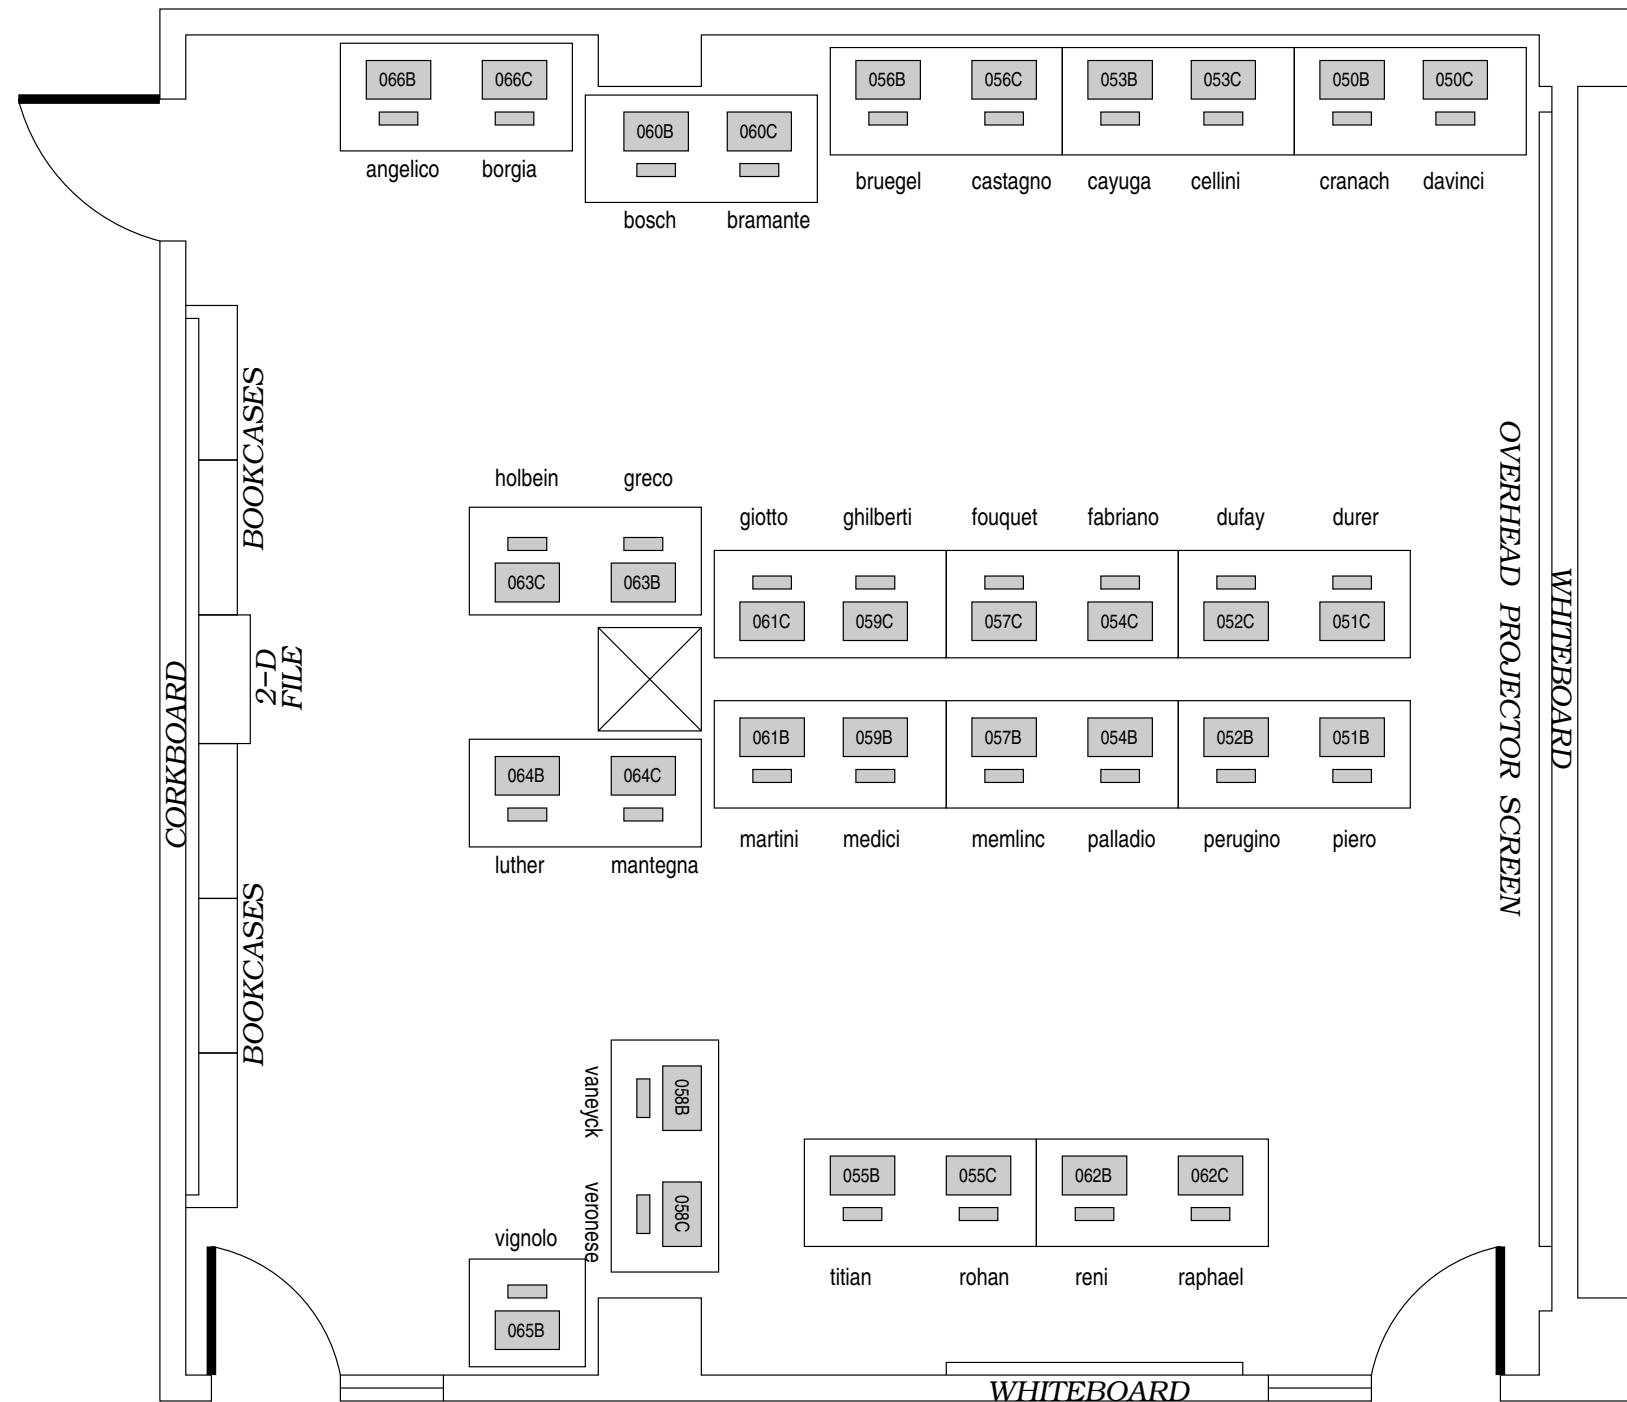

## PORT USAGE

|            |            |            |            |
|------------|------------|------------|------------|
| 2A-050-B + | 2A-055-B + | 2A-060-B + | 2A-065-B + |
| 2A-050-C + | 2A-055-C + | 2A-060-C + | 2A-065-C - |
| 2A-051-B + | 2A-056-B + | 2A-061-B + | 2A-066-B + |
| 2A-051-C + | 2A-056-C + | 2A-061-C + | 2A-066-C + |
| 2A-052-B + | 2A-057-B + | 2A-062-B + |            |
| 2A-052-C + | 2A-057-C + | 2A-062-C + |            |
| 2A-053-B + | 2A-058-B + | 2A-063-B + |            |
| 2A-053-C + | 2A-058-C + | 2A-063-C + |            |
| 2A-054-B + | 2A-059-B + | 2A-064-B + |            |
| 2A-054-C + | 2A-059-C + | 2A-064-C + |            |

+ active

- inactive